



ITECO Ing. AG Hauptsitz


Realisierte Anlagen

- 1 KW Mülibach, Burgdorf 80 kW
- 2 KW Obermühle, Baar 150 kW
- 3 KW Salleri Chialsa, Nepal 400 kW
- 4 KW Guggenloch, Lüftsburg 120 kW
- 5 KW Stenna, Flims 1'700 kW
- 6 KW Perlen 1'000 kW
- 7 KW Trümpfer, Uster 400 kW
- 8 KW Seealpsee 2'400 kW
- 9 KW Trin Mulin 1'550 kW
- 10 KW Mettental, Sachslen 300 kW
- 11 KW Säge, Bürglen 400 kW
- 12 KW Lotzwil 100 kW
- 13 KW Untermühle (QS) 600 kW
- 14 KW Hagendorn (QS) 600 kW
- 15 KW Frauental (QS) 200 kW
- 16 KW Aesch 500 kW
- 17 KW Schiffli, Hirzel 60 kW
- 18 KW Wollerau 15 kW
- 19 KW Burgholz, Interlaken 300 kW

In Realisierung

- 20 KW Likhku IV, Nepal 120'000 kW

- 3 Nepal
- 20 Nepal

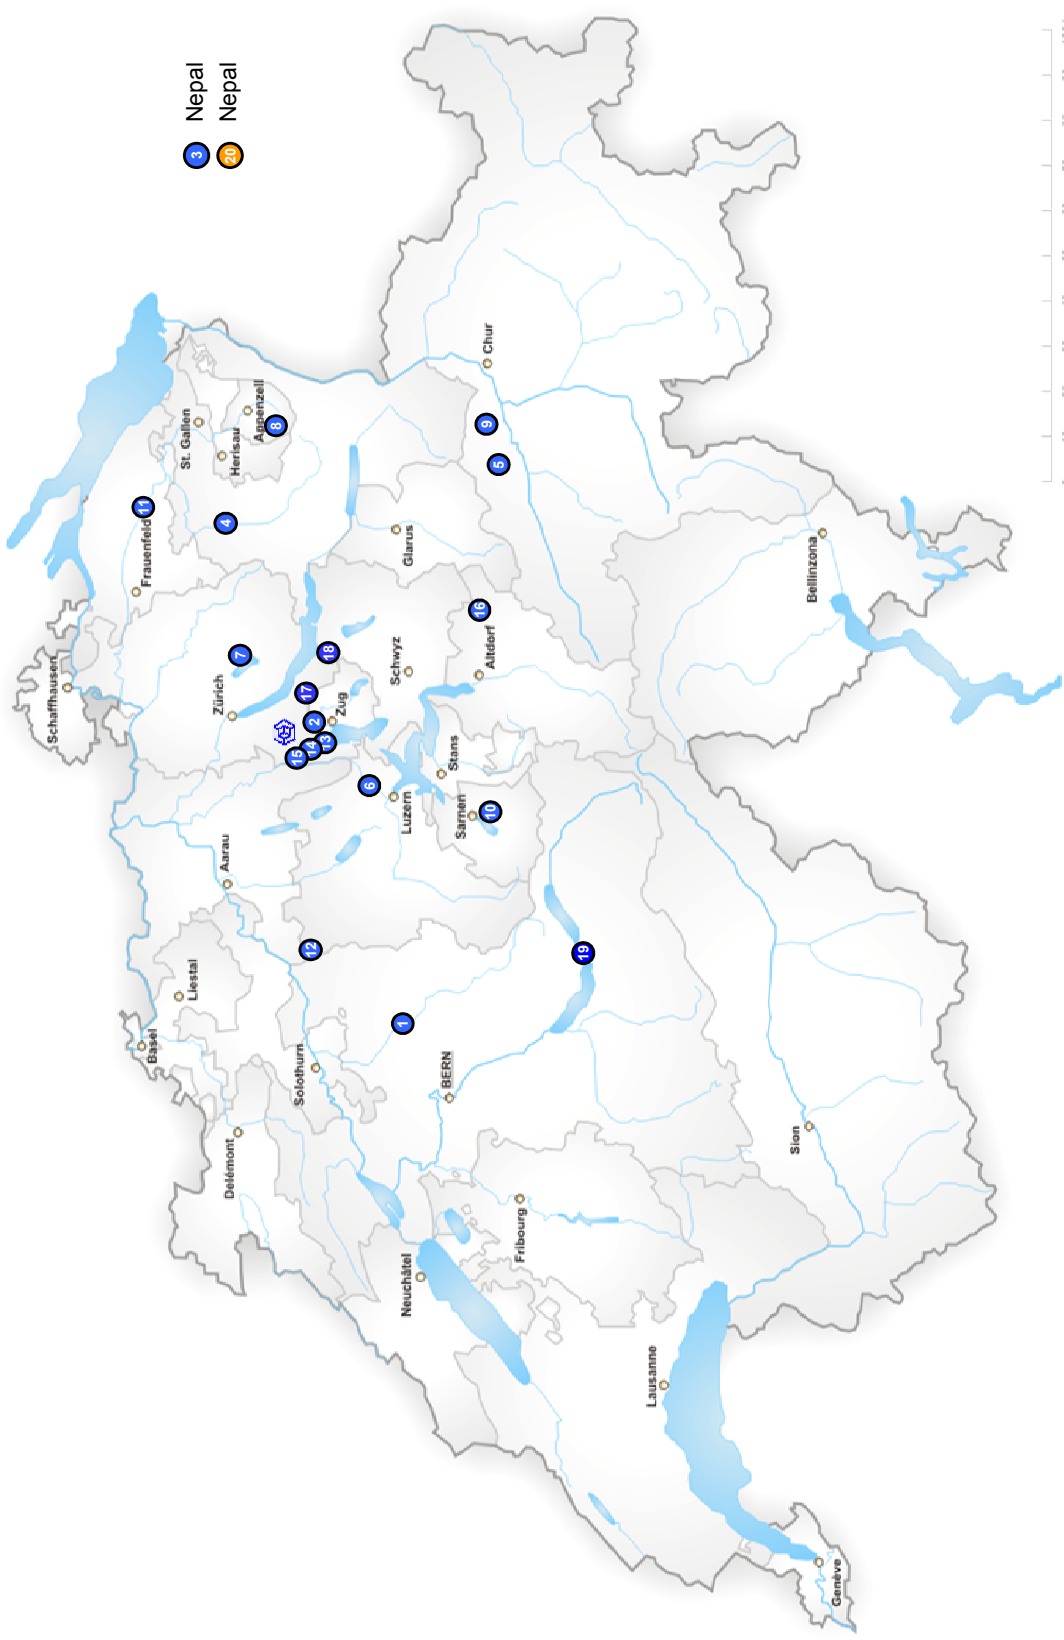



ITECO Eng. Ltd. Head Office

- | | |
|------------------------------|------------|
| Realised Plants | |
| 1 SHP Mülibach, Burgdorf | 80 kW |
| 2 SHP Obermühle, Baar | 150 kW |
| 3 SHP Salleri Chialsa, Nepal | 400 kW |
| 4 SHP Guggenloch, Lütisburg | 120 kW |
| 5 SHP Stenna, Flims | 1'700 kW |
| 6 SHP Perlen | 1'000 kW |
| 7 SHP Trümpler, Uster | 400 kW |
| 8 SHP Seelipse | 2'400 kW |
| 9 SHP Trin Mulin | 1'550 kW |
| 10 SHP Mettental, Sachslen | 300 kW |
| 11 SHP Säge, Bürglen | 400 kW |
| 12 SHP Lotzwil | 100 kW |
| 13 SHP Untermühle (QS) | 600 kW |
| 14 SHP Hagendom (QS) | 600 kW |
| 15 SHP Frauental (QS) | 200 kW |
| 16 SHP Aesch | 500 kW |
| 17 SHP Schiffli, Hirzel | 60 kW |
| 18 SHP Wollerau | 15 kW |
| 19 SHP Burgholz, Interlaken | 300 kW |
| Under implementation | |
| 20 HPP Likhku IV, Nepal | 120'000 kW |

